

Manual Load Dropping (MLD)


Power Supply Balance







NGCP shall inform all Grid users of any existing alert on the system

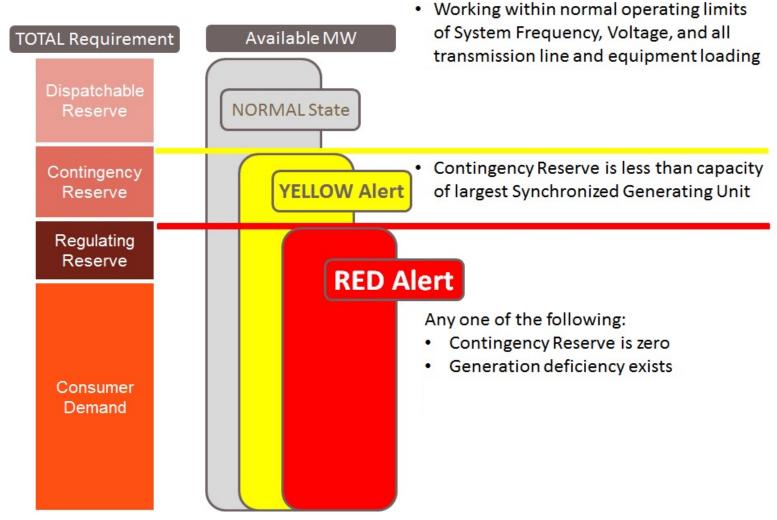

Source: PGC 6.4.1.1



MANUAL LOAD DROPPING (MLD)

Is conducted to limit the demand during RED Alert when the generation is insufficient or contingency reserve is zero.

MLD schedule is prepared and broadcasted by SCC as soon as SCC receive the forecasted hourly deficiency from NGCP. The duration is determined by the amount of energy deficiency in MWH.



Circuits from the main list are arranged according to their demand per customer count and classified into Residential, Commercial, and Industrial circuit.

Exempted circuits are omitted from the main list and the remaining circuits will be grouped depending on the forecasted hourly deficiency schedule by NGCP.

Residential and Commercial ckts. are scheduled to be dropped daytime

